

NOTES


1. DOUBLE CHECK DETECTOR ASSEMBLY WITH BYPASS METER SHALL BE UL-LISTED OR FM APPROVED FOR FIRE PROTECTION USE AND SHALL BE AS APPROVED BY U.S.C. FOUNDATION FOR CROSS-CONNECTION CONTROL AND HYDRAULIC RESEARCH. THIS ASSEMBLY IS TO BE USED FOR POLLUTION HAZARDS ONLY AS RECOMMENDED IN THE AWWA-M14 MANUAL.

2. ALL PIPING, VALVES, FITTINGS AND APPURTENANCES DOWNSTREAM OF THE SERVICE LINE SIDE CONTROL VALVE SHALL BE APPROVED FOR FIRE PROTECTION USE AND INSTALLED PER NFPA #24.

3. THE ENTIRE ASSEMBLY SHALL BE SECURED WITH CHAIN AND LOCK.

4. FDC AND PIV SHALL BE PAINTED RED.

5. FDC SHALL BE LABELED WITH PROPER SIGN TO INDICATE ADDRESS SERVED.

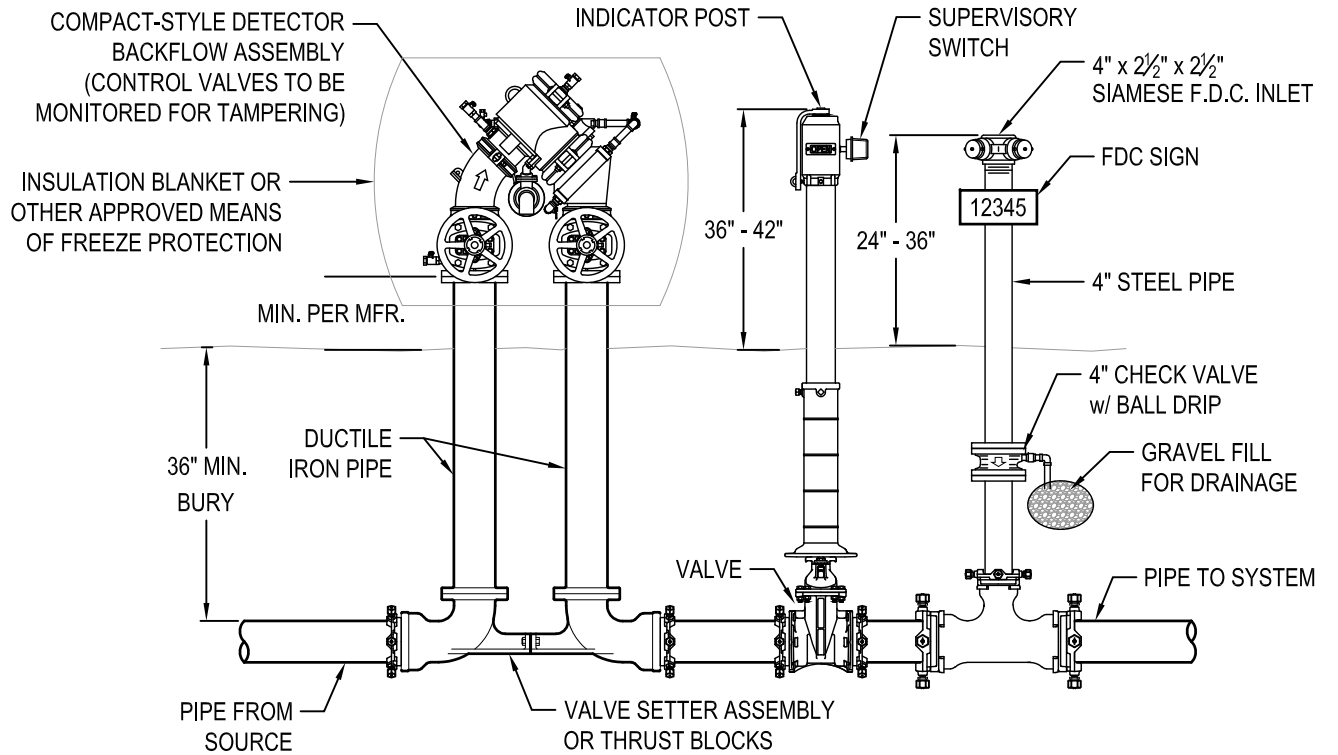

FIRE SERVICE
COMPACT-STYLE BACKFLOW ASSEMBLY

APPROVED BY:

B. PACHMAN - FIRE MARSHAL

DATE: FEBRUARY 6, 2019

FD102